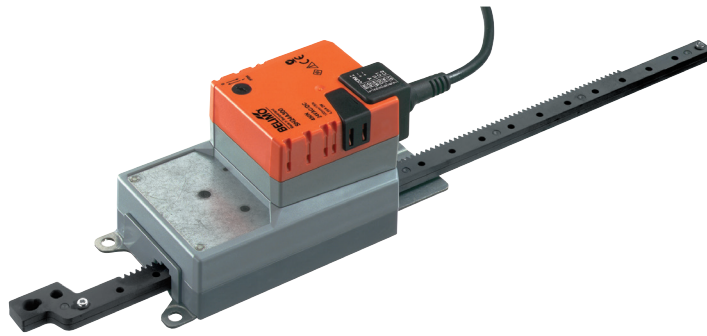


Linear actuator for adjusting dampers and slide valves in technical building installations

- Air damper size up to approx. 3 m<sup>2</sup>
- Actuating force 450 N
- Nominal voltage AC/DC 24 V
- Control Open/close, 3-point
- Length of Stroke Max. 300 mm, adjustable in 20 mm increments


**Technical data**

|                        |  |   |
|------------------------|--|---|
| <b>Electrical data</b> | Nominal voltage                        | AC/DC 24 V  |
|                        | Nominal voltage frequency              | 50/60 Hz  |
|                        | Nominal voltage range                  | AC 19.2...28.8 V / DC 19.2...28.8 V   |
|                        | Power consumption in operation         | 2 W   |
|                        | Power consumption in rest position     | 0.2 W   |
|                        | Power consumption for wire sizing      | 4.5 VA  |
|                        | Connection supply / control            | Cable 1 m, 3 x 0.75 mm <sup>2</sup>   |
|                        | Parallel operation                     | Yes (note the performance data)   |
| <b>Functional data</b> | Actuating force motor                  | 450 N   |
|                        | Direction of motion motor              | selectable with switch 0 (extended) / 1 (retracted)   |
|                        | Manual override                        | with push-button, can be locked   |
|                        | Stroke                                 | 300 mm  |
|                        | Length of Stroke                       | Max. 300 mm, adjustable in 20 mm increments   |
|                        | Stroke limitation                      | can be limited on both sides with mechanical end stops  |
|                        | Running time motor                     | 150 s / 100 mm  |
|                        | Sound power level, motor               | 52 dB(A)  |
| <b>Safety</b>          | Protection class IEC/EN                | III Safety Extra-Low Voltage (SELV)   |
|                        | Protection class UL                    | UL Class 2 Supply   |
|                        | Degree of protection IEC/EN            | IP54  |
|                        | Degree of protection NEMA/UL           | NEMA 2  |
|                        | Enclosure                              | UL Enclosure Type 2   |
|                        | EMC                                    | CE according to 2014/30/EU  |
|                        | Certification IEC/EN                   | IEC/EN 60730-1 and IEC/EN 60730-2-14  |
|                        | Certification UL                       | cULus according to UL60730-1A, UL60730-2-14 and CAN/CSA E60730-1:02                                   |
|                        | Certification UL note                  | The UL marking on the actuator depends on the production site, the device is UL-compliant in any case |
|                        | Mode of operation                      | Type 1  |
| <b>Weight</b>          | Rated impulse voltage supply / control | 0.8 kV  |
|                        | Control pollution degree               | 3   |
|                        | Ambient temperature                    | -30...50 °C   |
|                        | Storage temperature                    | -40...80 °C   |
|                        | Ambient humidity                       | Max. 95% r.H., non-condensing   |
|                        | Servicing                              | maintenance-free  |
|                        | Weight                                 | 1.2 kg  |

## Safety notes



- The device must not be used outside the specified field of application, especially not in aircraft or in any other airborne means of transport.
- Outdoor application: only possible in case that no (sea) water, snow, ice, insolation or aggressive gases interfere directly with the actuator and that is ensured that the ambient conditions remain at any time within the thresholds according to the data sheet.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.
- The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user.
- Cables must not be removed from the device.
- The rotary supports and coupling pieces available as accessories and must always be used if transverse forces are likely. In addition, the actuator must not be tightly bolted to the application. It must remain movable via the rotary support (refer to «Assembly notes»).
- If the actuator is exposed to severely contaminated ambient air, appropriate precautions must be taken on the system side. Excessive deposits of dust, soot etc. can prevent the gear rod from being extended and retracted correctly.
- If not installed horizontally, the gear disengagement push-button may only be actuated when there is no pressure on the gear rod.
- To calculate the actuating force required for air dampers and slide valves, the specifications supplied by the damper manufacturers concerning the cross section, the design, the installation site and the ventilation conditions must be observed.
- If a rotary support and/or coupling piece is used, actuation force losses are to be expected.
- The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

## Product features

|                                    |  |
|------------------------------------|--|
| <b>Simple direct mounting</b>      | The actuator can be directly connected with the application using the enclosed screws. The head of the gear rod is connected to the moving part of the ventilating application individually on the mounting side or with the Z-KS1 coupling piece provided for this purpose. |
| <b>Manual override</b>             | Manual override with push-button possible (the gear is disengaged for as long as the button is pressed or remains locked).   |
| <b>Adjustable stroke</b>           | If a stroke limitation will be adjusted, the operating range on this side of the gear rod can be used starting with an extension length of 20 mm and then can be limited respectively in increments of 20 mm by means of the mechanical end stops Z-AS1.                     |
| <b>High functional reliability</b> | The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.   |

## Accessories

|                               | Description                         | Type  |
|-------------------------------|-------------------------------------|-------|
| <b>Mechanical accessories</b> | End stop kit, Multipack 20 pcs.     | Z-AS1 |
|                               | Rotary support, for linear actuator | Z-DS1 |
|                               | Coupling piece M8                   | Z-KS1 |

## Electrical installation




### Notes

- Connection via safety isolating transformer.
- Parallel connection of other actuators possible. Observe the performance data.

## Electrical installation


### Wiring diagrams

AC/DC 24 V, open/close

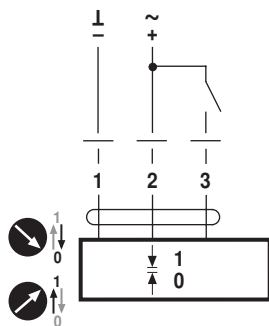


**Cable colours:**  
1 = black  
2 = red  
3 = white

Connection 3 takes priority

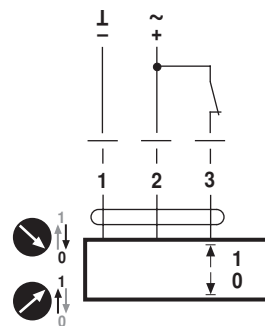

**Cable colours:**  
1 = black  
2 = red  
3 = white

AC/DC 24 V, 3-point

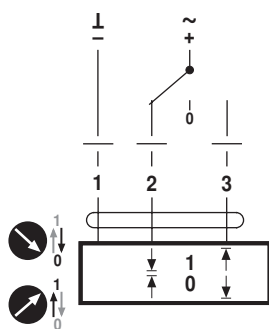

**Cable colours:**  
1 = black  
2 = red  
3 = white

### Installation notes



#### Notes

- If a rotary support and/or coupling piece is used, losses in the actuation force losses are to be expected.

#### Applications without transverse force

The linear actuator is screwed directly to the housing at three points. Afterwards, the head of the gear rod is fastened to the moving part of the ventilation application (e.g. damper or slide valve).

#### Applications with transverse forces

The coupling piece with the internal thread (Z-KS1) is connected to the head of the gear rod. The rotary support (Z-DS1) is screwed to the ventilation application. Afterwards, the linear actuator is screwed to the previously mounted rotary support with the enclosed screw. Afterwards, the coupling piece, which is mounted to the head of the gear rod, is attached to the moving part of the ventilating application (e.g. damper or slide valve). The transverse forces can be compensated for to a certain limit with the rotary support and/or coupling piece. The maximum permissible swivel angle of the rotary support and coupling piece is 10° (angle), laterally and upwards.

Dimensions [mm]

Dimensional drawings

