

Room sensor Humidity / Temperature

For measuring the temperature and humidity in the room. The room units can be seamlessly connected to existing third-party controllers. With MP-Bus communication and integrated 0...10 V output. Output signal is selectable via NFC.


Type Overview

Type	Communication	Output signal active humidity	Output signal active temperature
22RTH-19-1	MP-Bus	0...5 V, 0...10 V, 2...10 V	0...5 V, 0...10 V, 2...10 V

Technical data

Electrical data	Nominal voltage	AC/DC 24 V	
	Nominal voltage range	AC 19.2...28.8 V / DC 19.2...28.8 V	
	Power consumption AC	1 VA	
	Power consumption DC	0.5 W	
	Electrical connection	Spring loaded terminal 0.25...1.5 mm ²	
	Cable entry	Wire openings at the backside (for In-wall wiring) and top-/bottom side (for On-wall wiring)	
Functional data	Application	Air	
	Communication	MP-Bus	
	Voltage output	2x 0...5 V, 0...10 V, 2...10 V, min. load 10 kΩ	
	Output signal active note	Output 0...5 V, 0...10 V (factory setting), 2...10 V selectable via NFC	
Measuring data	Measured values	Relative humidity Dew point Temperature	
	Measuring range humidity	0...100% RH	
	Measuring range temperature	0...50°C [32...122°F]	
	Accuracy humidity	±2% between 0...80% RH @ 25°C	
	Accuracy temperature active	±0.5°C @ 25°C [±0.9°F @ 77°F]	
	Long-term stability	±0.50% RH p.a. @ 25°C @ 50% RH ±0.03°C p.a. @ 25°C [±0.05°F p.a. @ 77°F]	
	Time constant τ (63%) in the room	Typical 960 s	
	Wall coupling factor	52 %	
	Materials	Housing	PC, white, RAL 9003
	Safety data	Ambient humidity	Max. 95% RH, non-condensing
Ambient temperature		0...50°C [30...120°F]	
Storage temperature		-20...60°C [-5...140°F]	
Protection class IEC/EN		III, Protective Extra-Low Voltage (PELV)	

Safety data	EU Conformity	CE Marking
	Certification IEC/EN	IEC/EN 60730-1 and IEC/EN 60730-2-9
	Degree of protection IEC/EN	IP30
	Quality Standard	ISO 9001

Safety notes


This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application. Unauthorised modifications are prohibited. The product must not be used in relation with any equipment that in case of a failure may threaten humans, animals or assets.

Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Remarks
General remarks concerning sensors

The measuring result is influenced by the thermal characteristics of the wall. A solid concrete wall responds to thermal fluctuations within a room slower than a light-weight structure wall. Room temperature sensors installed in flush-mounted boxes have a longer response time to thermal variations. For example, in extreme cases they will detect the radiant heat of the wall even if the air temperature in the room is lower. The quicker the dynamics of the wall (temperature acceptance of the wall) or the longer the selected inquiry interval of the temperature sensor is, the smaller the deviations are.

Build-up of self-heating by electrical dissipative power

Temperature sensors with electronic components always have a dissipative power which affects the temperature measurement of the ambient air. The dissipation in active temperature sensors shows a linear increase with rising operating voltage. The dissipative power should be taken into account when measuring temperature. In case of a fixed operating voltage (± 0.2 V) this is normally done by adding or reducing a constant offset value. As Belimo transducers work with a variable operating voltage, only one operating voltage can be taken into consideration, for reasons of production engineering. Transducers 0...10 V / 4...20 mA have a standard setting at an operating voltage of DC 24 V. That means, that at this voltage, the expected measuring error of the output signal will be the least. For other operating voltages, the offset error will be increased by a changing power loss of the sensor electronics.

If a readjustment directly at the active sensor should be necessary during later operation, this can be done with the following adjustment methods.

- For sensors with NFC or dongle by the corresponding Belimo app
- For sensors with a trimming potentiometer on the sensor board
- For bus sensors via bus interface with a corresponding software variable

Application notice for humidity sensors

Refrain from touching the sensitive humidity sensor element. Touching the sensitive surface will void warranty.

When exposed to harsh environmental conditions such as high ambient temperature and/or high levels of humidity, or presence of aggressive gases (i.e. chlorine, ozone, ammonia), the sensor element may be affected and readings may be outside the specified accuracy. Replacement of deteriorated humidity sensors due to harsh environmental conditions is not covered by the general warranty.

The sensor shows best performance when operated within recommended normal temperature range of 5...60°C and humidity range of 20...80% RH. Long-term exposure to conditions outside normal range, especially at high humidity, may temporarily offset the humidity signal (e.g. +3% RH after 60h kept at >80% RH). After returning into the normal temperature and humidity range, the sensor will slowly come back to calibration state by itself.

Digital input

Auxiliary Digital Input can be used with third-party sensors and switches (window alarm, occupancy detector, etc.). The input values are monitored and transmitted only through the MP-Bus communication protocol.

Scope of delivery


Screws

Accessories


Service tools	Description	Type
	Belimo Assistant App, Smartphone app for easy commissioning, parametrising and maintenance Converter Bluetooth / NFC	Belimo Assistant App ZIP-BT-NFC

Service


- NFC connection** Belimo equipment marked with the NFC logo can be operated and parameterized with the Belimo Assistant App.
- Requirement:
- NFC- or Bluetooth-capable smartphone
 - Belimo Assistant App (Google Play & Apple AppStore)
- Align NFC-capable smartphone on the sensor so that both NFC antennas are superposed.
- Connect Bluetooth-enabled smartphone via the Bluetooth-to-NFC Converter ZIP-BT-NFC to the sensor. Technical data and operation instructions are shown in the ZIP-BT-NFC data sheet.

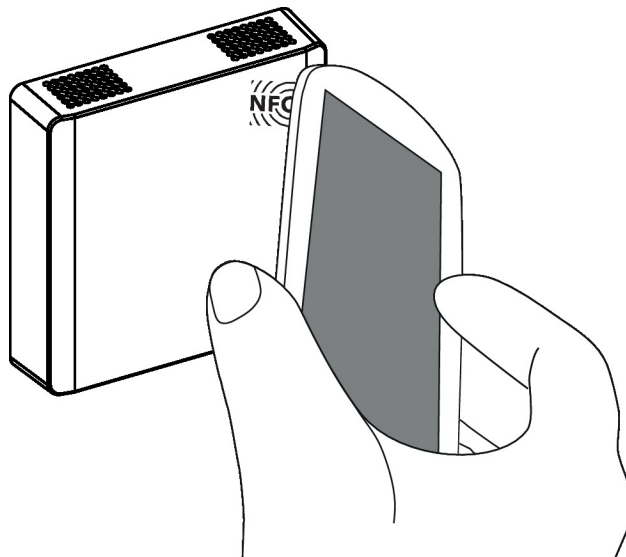

Wiring diagram

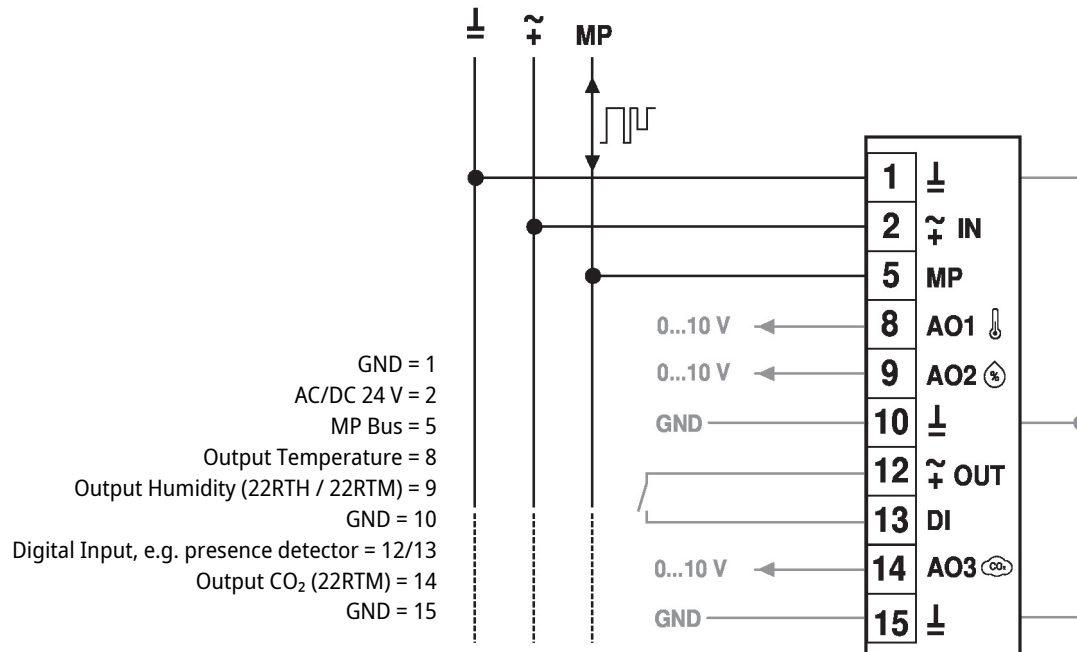

Dimensions

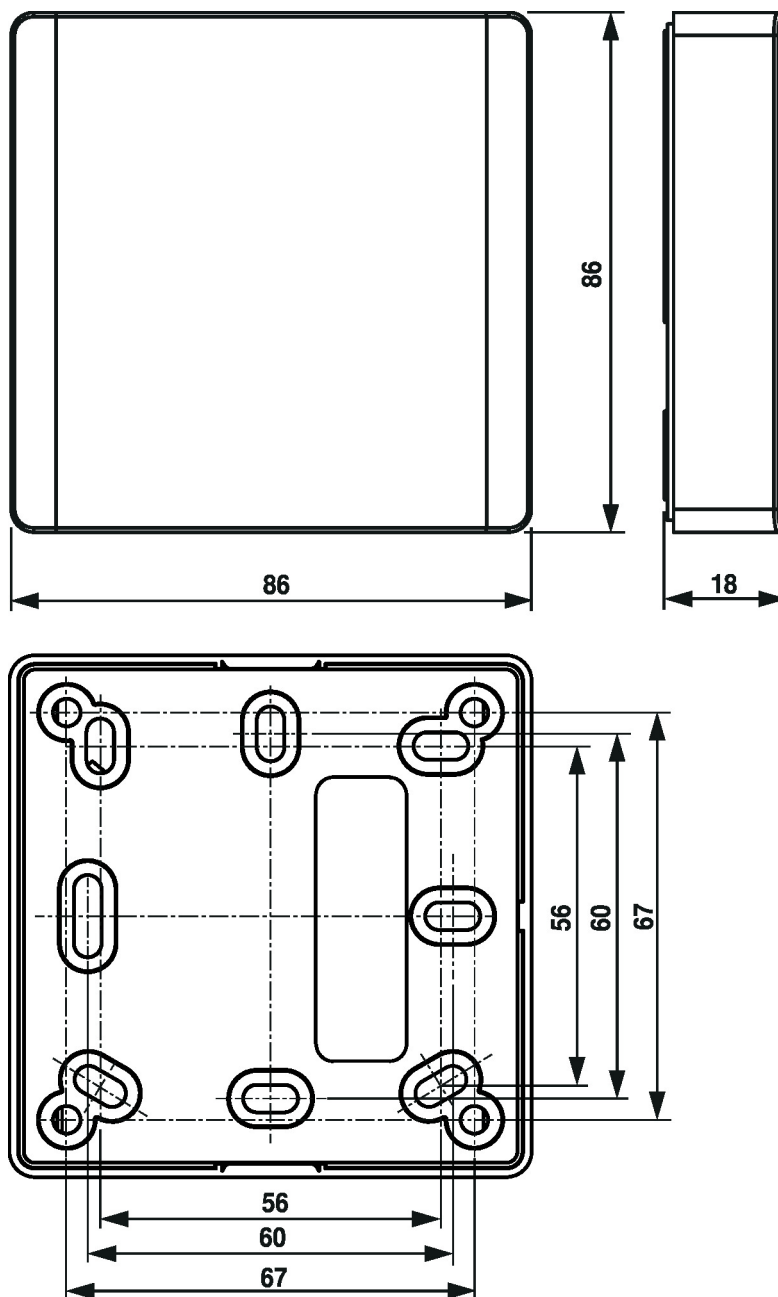

Type

22RTH-19-1

Weight

0.113 kg